

Monitoring and analysis of low-voltage network with smart grid architecture model by developing use cases

Haresh Kumar^{1,*}, Jagdesh Kumar²
and Jherna Devi³

¹School of Technology and
Innovations, University of Vaasa,
Vaasa, Finland.

²School of Technology and
Innovations University of Vaasa,
Vaasa, Finland and Department
of Electrical Engineering, Quaid-
e-Awam University of Engineering
Science & Technology (QUEST),
Nawabshah, 67480, Sindh,
Pakistan.

³Institute of Technology for
Nanostructures (NST) and Center
for Nano Integration Duisburg-Essen
(CENIDE), University Duisburg-
Essen, Duisburg D-47057, Germany
and Department of Information
Technology, Quaid-e-Awam
University of Engineering Science &
Technology (QUEST), Nawabshah,
67480, Sindh, Pakistan.

*E-mail: hk.sangtani@gmail.com

This paper is edited by
Subhas Chandra Mukhopadhyay.

Received for publication
September 04, 2020.

Abstract

The objective of this paper is to show the characteristics of smart meters enabling to monitor and analyze the low-voltage (LV) network. This is achieved by developing use cases, where power quality and outage data are transferred from smart meters through distribution network to the control center. To visualize the monitoring process of LV network, the use cases are mapped into smart grid architecture model. The paper proposes a solution to analyze the LV network interruption and power quality problems (over-voltage, under-voltage, voltage sags, and swells). Thus, this paper provides a smart platform for monitoring LV network.

Keywords

Advanced metering infrastructure, Outage management, Power quality monitoring, Use cases, Smart grid architecture model.

The rapid transition of smart meters from traditional meters has provided many benefits to utilities, distribution system operators (DSOs) and customers. The customers can check the hourly consumption data for electricity usage and control their energy usage by receiving tariff information. Smart meters enable DSO to get state estimation, interruption measurement, and asset management. The information regarding interruption measurement can be gathered by deploying smart meters at the customer level and at the substation level, which reduces the time at the control center to identify the affected power supply area.

Initially, automatic meter reading (AMR) meters were deployed to read the electricity energy consumption with one-way communication for accurate billing, and for reducing the cost of labor for a meter reading. However, after the invention of advanced metering infrastructure (AMI), the smart meters with two-way communication participated in different operations, such as tamper detection, theft detection, managing peak demand, fault management, power quality monitoring, and network planning. The smart meters are a part of the AMI network that uses different information and communication technology (ICT) solutions to send and receive the data. The collected data can be analyzed and utilized for other purposes (data mining for smart home solution), consisting of consumption data, events and alarms (Wang et al., 2016).

The interest of extended real-time monitoring for low-voltage (LV) network increased after the rapid growth in the penetration of distributed energy resources (DER) in the LV grid. Before integrating DER, the distribution companies were only interested in high voltage and medium

voltage level monitoring. Nowadays, smart meters are used as an extended system of supervisory control and data acquisition system (SCADA) for monitoring and controlling of the end-points of the LV network (customers). The deployment of smart meters has reduced the number of current sensors, which can be used at feeder level for real-time monitoring of the LV network. The current sensors solution is costly, and for accurate real-time monitoring, we need voltage information as well, and voltage sensors will also increase the cost. Thus, a smart meter is a best-preferred solution for monitoring of LV network (Kauppinen et al., 2012).

There are different types of meters available in the market, which are manufactured by different vendors with different functionalities. In the INTEGRIS project (Pikkarainen et al., 2013), two types of meters have been used: a smart meter (SM) and a power quality meter (PQM). The smart meter provides fundamental quantities such as current, voltage, power, and reactive power, while PQM offers information about power quality problems such as flicker, harmonic distortion, etc. The PQM information is not enough to determine the power quality issues in the distribution network. Thus, the evaluation is required based on other measurement units, such as remote terminal unit (RTU), SMs, and estimated values. From the power quality point of view, SM measurements are providing only voltage level information. The advantage of using PQM measurements over SM is that the PQM measurements give an indication of voltage dips, fuse blown, and interruption information (Pikkarainen et al., 2013).

A centralized distribution network management system is presented in the paper (Repo et al., 2011) for LV network management. However, the centralized distribution network architecture is shown in general. The details about data type and its exchange between the systems involved in the distribution network management system are not provided. For LV network management, the following questions are addressed in this paper:

- How can smart metering data be utilized for the use cases of the LV network?
- What types of communication infrastructures are available for smart grid applications, and which one is suitable for LV network?
- Which protocols and standards are available to support communication media of the use cases?

To address the above research questions, use cases are designed to show the systematic analysis

of data at different distribution network stages. The smart grid architecture model (SGAM) framework is introduced in this paper to cover use cases from the technical, functional, and market point of view.

A use case is the best way of describing the goals and requirements of actors involved in the LV monitoring process. The mapping of use cases into the SGAM framework makes it easier to understand the functionalities and sub-functionalities of use cases. This paper focuses on the use cases of power quality monitoring and outage identification, classification, and management. The main objective of this paper is to identify the outages and power quality problems at the LV network and send this information to the control center with the help of developing use cases. The second objective of this paper is to select the communication infrastructures for use cases. To achieve the second objective, different communication architectures used in various projects are reviewed, and communication performance indicators (latency, throughput, the data rate per packet, and response time) are compared to select communication infrastructure.

This paper is organized into five sections, including Introduction. The second section explains the use cases of outage identification, classification and management, and power quality monitoring with their LV network operation benefits. In the third section, the use cases are mapped into the SGAM framework with an emphasis on the implementation of communication media and protocols for LV network monitoring. The fourth section presents the discussion of this paper, and finally the last section summarizes this paper.

Use cases

For any system analysis, a use case can be used as a methodology to identify, clarify, and organize system requirements. In this paper, the use cases are classified into two categories: outage identification classification and management, and power quality monitoring. These use cases are classified into two groups to know the interruption problems and improve the quality of service by maintaining the LV distribution network's reliability. Besides, to improve the network's quality, network planning can be achieved more efficiently with the help of these use cases.

Before designing a use case, it is necessary to know each system's functionalities involved in use case design. Table 1 shows the systems with their description, which are employed in the use case design.

Table 1. Systems and their description (Löf et al., 2011).

Systems	Description
SCADA	The SCADA system is used at the control center for monitoring the data from field devices (RTU, current sensors, re-closers and breakers). The monitoring process is achieved by measuring the status of field devices and by forwarding this information to the distribution management system (DMS)
GIS	The GIS stands for the global information system. The GIS is a digital database that uses spatial coordinates as a primary source of data. A GIS collects and stores the data input (maps, coordinates) into the database, and after analyzing, it generates the report about power supply affected area (power quality and outage problems)
NIS	The NIS stands for the network information system. The NIS is a software-based platform that is responsible for networking planning, automatic mapping and information management. The NIS system holds information about network topology, transmission lines and protection devices of the distribution network
CIS	The CIS stands for the customer information system. The CIS consists of customer ID and customer meter number, physical addresses and phone numbers of customers. The CIS helps the utility company for billing and to network operating company for identifying the exact location of customer by generating a trouble call from a particular smart meter
OMS	The OMS stands for the outage management system, which analyses the outages at the customer level. The integration of OMS in the distribution network has reduced the outage cost and outage duration. The OMS receives the information from SCADA and DMS and starts the outage management process by obtaining the required data from other systems (GIS, CIS, and NIS)
DMS	The DMS uses different applications for monitoring and controlling the distribution network. The integration of DMS has increased the reliability and quality of the entire electric distribution network. The DMS receives the information from the customer level and the substation level, and after analyzing the whole network, it takes the decision. In some countries, the DMS and OMS are used as separate systems, but it is used as a single system in this research

Two use cases are designed in this paper by integrating actors (customer, SM, PQM, Intelligent Electronic Devices (IEDs)) and these systems (SCADA, GIS, NIS, CIS, OMS, DMS). The first use case determines the outage problems, while the second one focuses on power quality problems in the LV network.

Use case of outage identification, classification, and management

This use case describes how the outage information is received from a smart meter. The outage data can be exported to different systems for checking and verifying outages in the distribution network.

In this use case, the smart meters periodically measure the voltage and current at end-points (consumers) of the distribution network. Regulators set the threshold voltage levels to ensure the reliability of a network and quality of electric supply. When voltage levels change from the predefined value, smart meters generate events and alarms and send this information

to DMS/OMS followed by different operating systems between DMS/OMS and a smart meter. For single or two-phase faults, it generates phase missing alarm separately for each phase, and for three-phase fault, it generates the last gasp message alarm. The outage information is confirmed by DMS/OMS with the help of SCADA and CIS by checking the planned outages and filtering out the events by knowing the issues in the distribution network. The following steps are required for this use case:

- A smart meter measures the voltage levels.
- Smart meter generates the alarm for an outage.
- DMS/OMS receives the information.
- DMS/OMS confirms the outages by checking planned/unplanned outages by employing SCADA, CIS and NIS.

To understand the procedure applied in the use case design in a visual format, some diagrams are presented in figures. Figure 1 shows the data

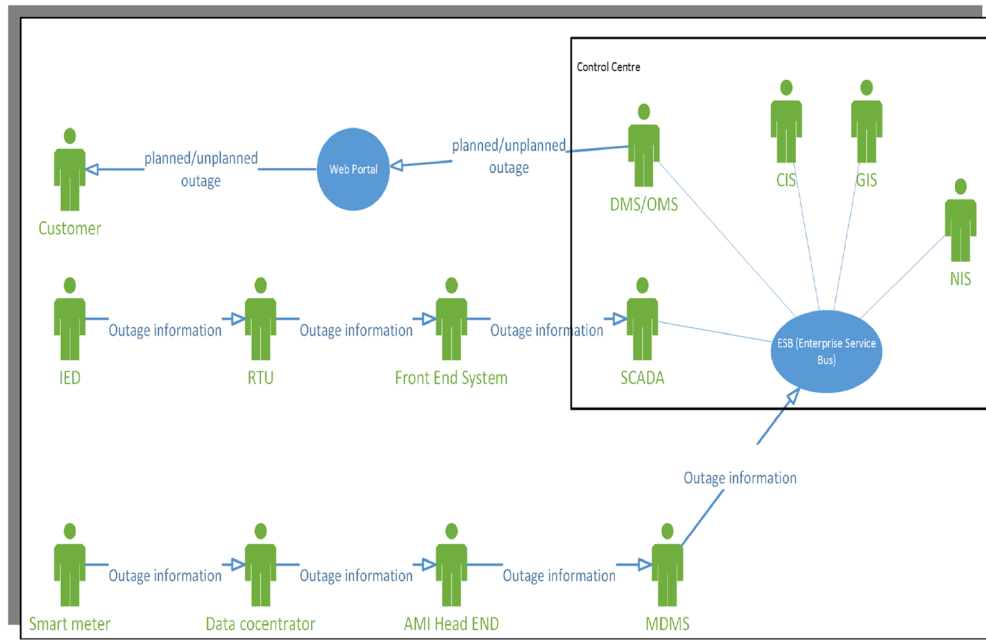


Figure 1: Outage management use case with associated actors.

transmission process from smart meters and from IEDs during outage events and the systems involved for data collection. Figure 1 depicts that a smart meter sends the outage information to the data concentrator (DC) during three-phase fault at the customer location, while an IED is placed at the secondary substation, which sends the outage information to RTU during the fault at the secondary substation. The outage information is transferred to the control center from IEDs and a smart meter via different information systems (RTU, front end system, DC, AMI head end, meter data management system (MDMS), etc.), where further actions can be taken based on the collected information. For sending outage information to the control center, an enterprise service bus (ESB) is utilized which facilitates the services of service-oriented architecture (SOA) and serves as an integrating bus for information systems at the control center. To forward the outage data from RTU to SCADA and then to DMS via ESB, the front-end system, which acts as an interface between SCADA and RTU, is used. For notifying the customer about the cause and duration of the interruption, a web portal is utilized.

Figure 2 shows the sequence diagram, representing the type of data exchange between different systems and actors for sending outage information to the control center. At first, the outage information is sent to DMS/OMS from different actors and systems

in parallel to information from SCADA. Then, DMS/OMS identifies the planned and unplanned outages. For planned outages, DMS/OMS confirms the outage information (outage location and affected customers) from GIS and NIS along with the information (data) collected from SCADA and MDMS via ESB. In contrast, for unplanned outages, it only confirms the outage location and affected customers from GIS and CIS. The collected information (planned or unplanned outages) is then sent to the customer via the web portal. Moreover, queries are generated by the control center for smart meters to ensure the occurrence of the outage and its location.

Figure 3 depicts the query (ping) and response process for finding the outage's exact location. At first, the query is generated by DMS/OMS to MDMS via ESB, and then this process is continued until getting the response of smart meters. For identifying the fault at the customer level, an event is generated from DC, which can be used to distinguish the faults at secondary substations from the fault at the end customer. A ping request is then sent to all smart meters for getting their acknowledgement signals to confirm their online status. In this way, outage location is confirmed by getting response or acknowledgement signals from smart meters, AMI head end, DC, MDMS, and by getting information from CIS and GIS. After the confirmation of the outage location, the information is updated on the web portal.

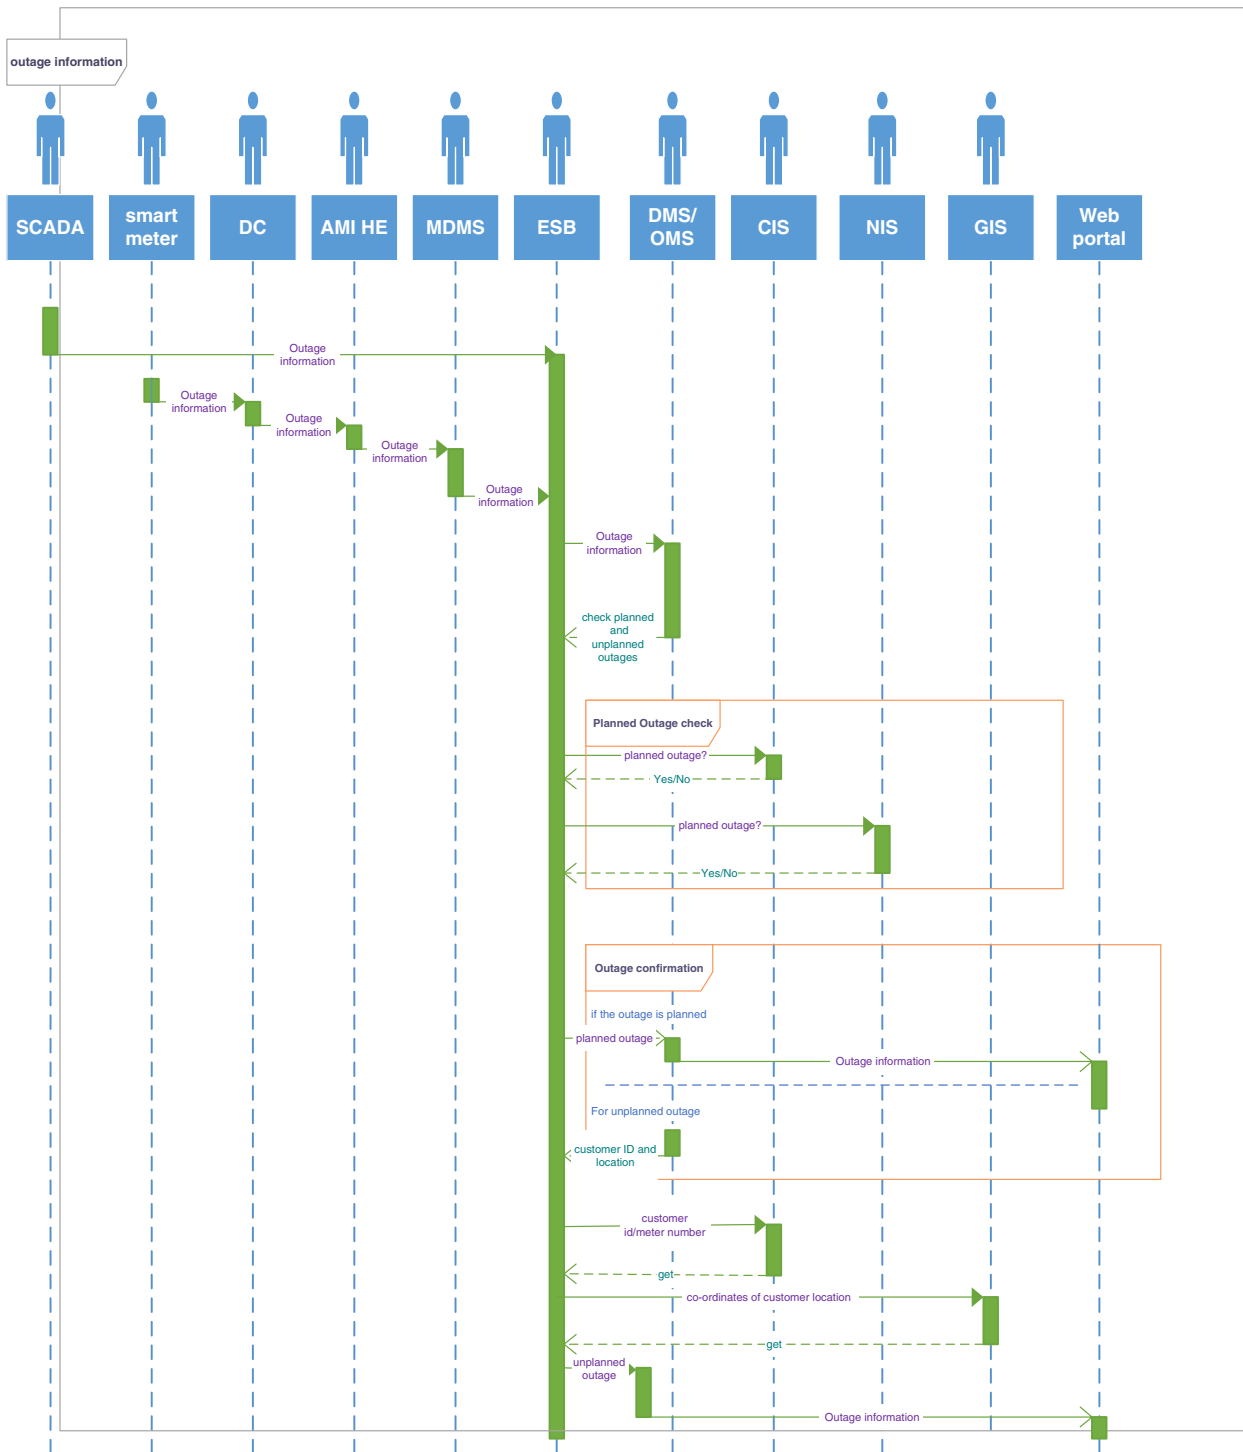


Figure 2: Outage management sequence diagram.

This use case visualizes how different participants/stakeholders can observe the process of identification, classification, and management of fault at LV network.

Furthermore, the collected metering data at DC can be utilized for different purposes, such as intelligent algorithms (estate estimation and voltage control) can

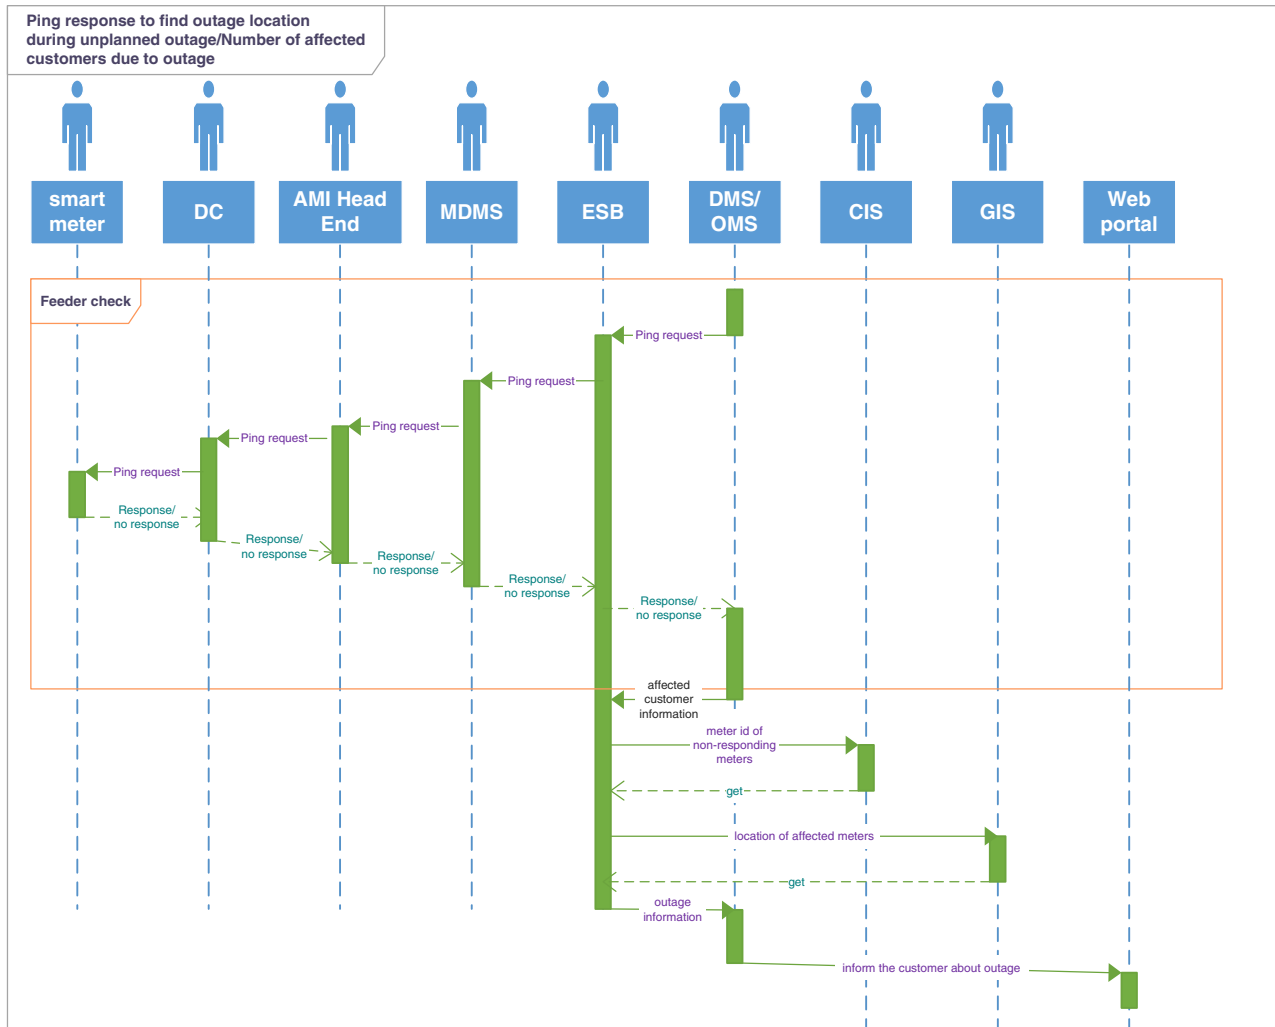


Figure 3: Outage management sequence diagram (ping response).

be implemented for the self-healing of LV network which can be applied at the secondary substation.

Use case of power quality

In the transmission of power from generation to consumption, the power quality is affected due to various factors, such as weather, transmission cables, failure of protection devices, the malfunctioning of devices, overloading, disturbances from the customer, switching off equipment, distortion factors, etc. This use case illustrates how smart meter data is used to analyze the power quality problems at the LV network.

The power quality events based on voltage thresholds are defined by standard EN 50160. The purpose of this use case is to transfer the power quality events or alarms generated by a smart meter

to DMS and to power quality database. In this use case, the PQM device measures the power quality quantities (voltage dips, flicker and harmonics) at the substation level, and sends this information to an intermediate data collection system for power quality (PQ) devices. Moreover, the PQM device measures other quantities, such as; fuse blown, an indication of voltage dips, and interruptions for 10min interval. The intermediate data collection system for PQ devices receive the power quality information from all other PQ devices installed at the LV network and sends the collected information to MDMS.

For monitoring the power quality in the MV network, the RTU provides phase voltage unbalance, phase voltage level, and total harmonic distortion of phase voltage information. These measurements are taken approximately every 1.5min and transferred to

the 10-min average value for power quality monitoring purpose (Pikkarainen et al., 2013).

The consequences of power quality problems are economic losses. It was found that 90% of losses (production loss, equipment loss, work costs, labor costs, monetary losses due to replacement of system devices) were observed for the industry sector. Thus, power quality is a significant issue that has a considerable impact on the economy (Amaripadath et al., 2017).

Figure 4 shows how power quality data is transmitted from smart meters and from IEDs to control center. As compared to the previous use case, here an additional PQM device is used which measures the power quality from substation level. To avoid the congestion of power quality data, an intermediate data collection system for PQ devices (PQDB) is used in this use case which gathers the power quality data from MDMS and PQ devices. After collecting the power quality data, the PQDB sends this information to the control center, where DMS/OMS identifies the power quality issues in the distribution network and updates this information on the web portal to inform the customer.

The sequence diagram of this use case is different from the previous use case because two additional actors (PQM device and PQDB) are used to measure and collect power quality information.

The sequence diagram in Figure 5 explains how power quality information is checked at the feeder and substation levels. If power quality issue is identified at feeder level, the number of affected customers on that feeder is recognized, and this information is transferred to the web portal. If power quality issue affects several feeders, the power quality information is determined at the substation level, and this information is transferred to the web portal. For this purpose (identifying power quality issue at the feeder or substation level), DMS/OMS defines the threshold values and gets the information from PQDB.

The advantage of this use case is that it provides power quality information from the LV network and shows the relationship between different power quality measurement devices and field devices (RTU, SCADA) of the distribution network. This use case can be utilized for determining the network-holding capacity.

ICT solution for use cases

The ICT solution defines the requirements and conditions for integrating different actors and systems used in the use cases. To achieve the integration requirements and meet the goals of use cases, it is required to design the use cases so that its scope and

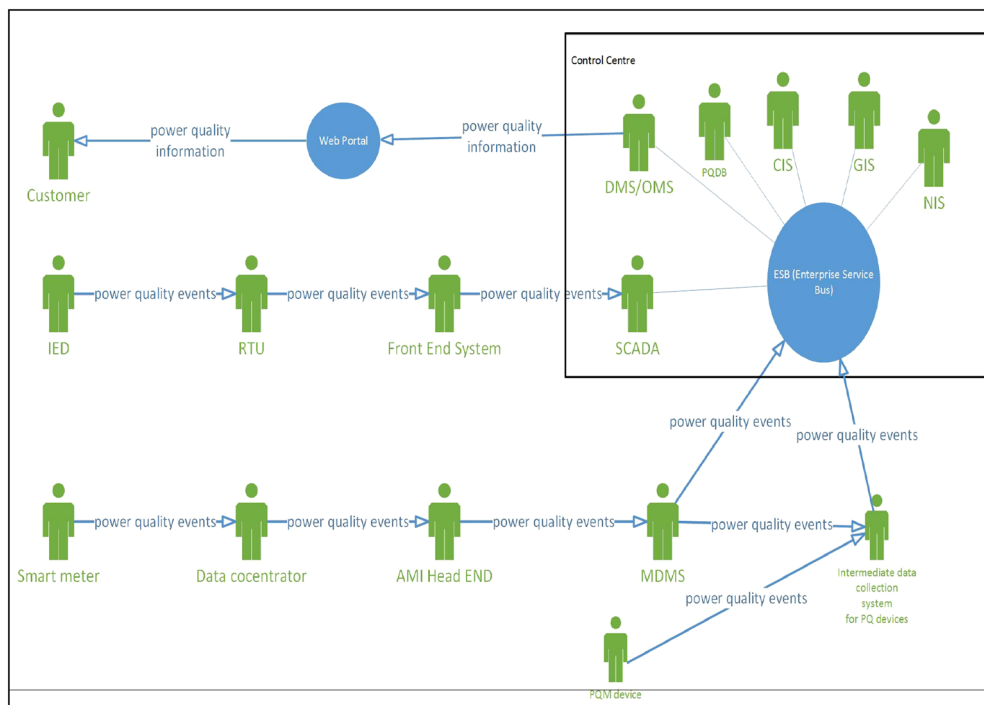


Figure 4: Power Quality use case with associated actors.

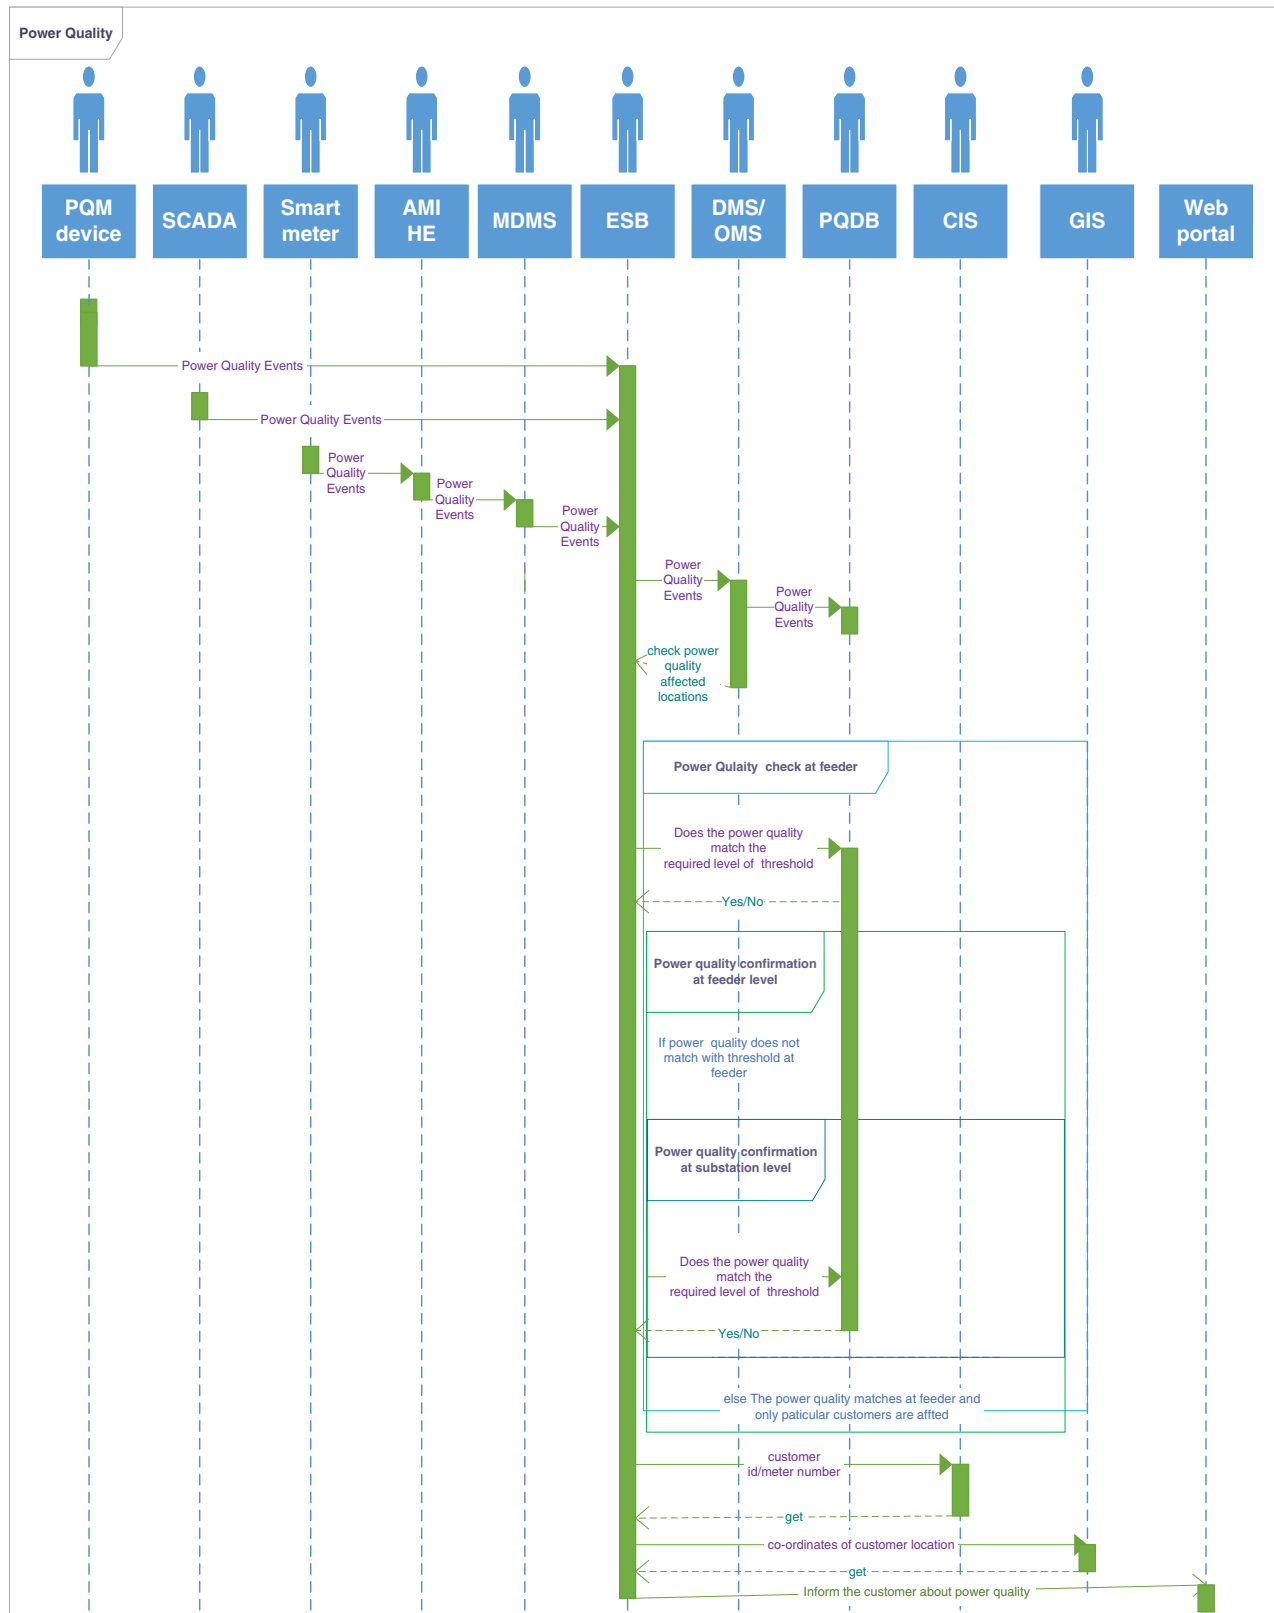


Figure 5: Power quality sequence diagram.

objectives would be clearly defined. For this purpose, the SGAM framework is used, which explains ICT solution behavior in a physical distribution system.

The SGAM provides the most straightforward way to illustrate the smart grid-related functionalities and explains how three-dimensional (zone plane, domain plane, and interoperability layers) architecture is used to describe the use case and sub functionalities of the use case in a pictorial form. The domain (one-dimensional smart grid plane) shows the stages involved in the transmission of electrical energy from generation to customers, while zone shows how the management of power system is divided hierarchically into six zones, namely, process, field, station, operation, enterprise, and market. The interoperability layers represent how devices and communication technologies are integrated that belongs to different layers of interoperability (Bruinenberg et al., 2012).

There are three approaches for mapping the use cases: top-bottom, bottom to top, and mix approach. The difference between the bottom to top and top to bottom approach is that the bottom to top approach is preferred for the technical implementation of a specific use case which meets the one or two business objectives. On the contrary, in

the top to bottom approach, a general or high-level use case is described, and the use case's concrete implementation is unknown. The mixed approach is the combination of both approaches, and it does not follow any sequence in the mapping process of use case. In the mixed approach, each layer is designed randomly, unlike top-bottom and bottom-to-top approaches that follow the designing sequence. In the mixed approach, at first component and business layers are developed, and then the function layer is created based on the information and needs of the business layer. In the end, information and communication layers are developed (Radi et al., 2019). In this paper, the bottom to top approach is applied (e.g. start mapping use cases into SGAM from component layer to the business layer) to meet the business objectives (monitoring of outage and power quality problems at LV network) of use cases. The bottom to top approach is applied here because data are generated from smart meters and from IEDs, which is forwarded to DMS/OMS for further actions. In the mapping process, smart meters, IEDs and PQMs are placed at the component layer, while DC, PQDB and RTU are placed at the communication layer of SGAM. Figure 6 describes

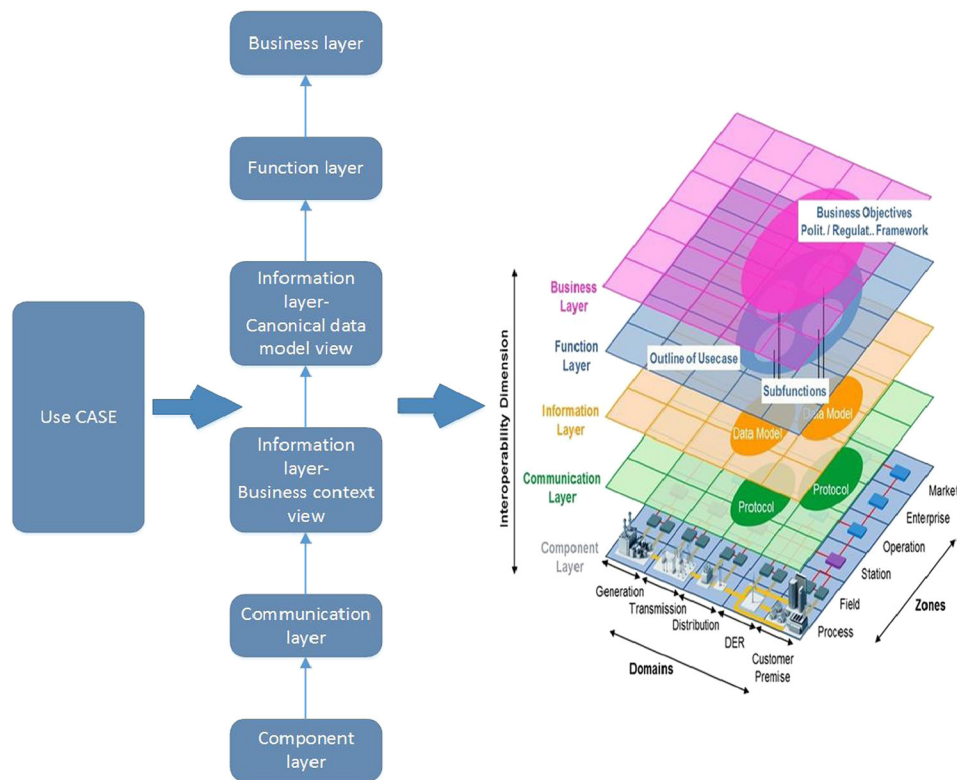


Figure 6: Mapping of use case into SGAM (Radi et al., 2019).

the systematic mapping of a use case into the SGAM framework.

For LV network monitoring, the deployment of communication infrastructure and how different components communicate are big decisions. For a communication system, secure data and reliable high-speed information transfer are essential parameters that should be effectively managed by a smart power network (Sharma et al., 2019). In this section, different communication technologies, communication protocols and communication infrastructures are presented,

and discussion is carried out to select suitable communication infrastructure for the use cases of this paper.

The communication layer (the second layer of SGAM) describes in what fashion or how different devices are connected and which communication technologies, communication protocols are used (Uslar et al., 2019). For the use cases of this paper, the communication layer is designed to map the use cases into the SGAM framework and to visualize the integration process of different actors and systems, which is shown in Figure 7.

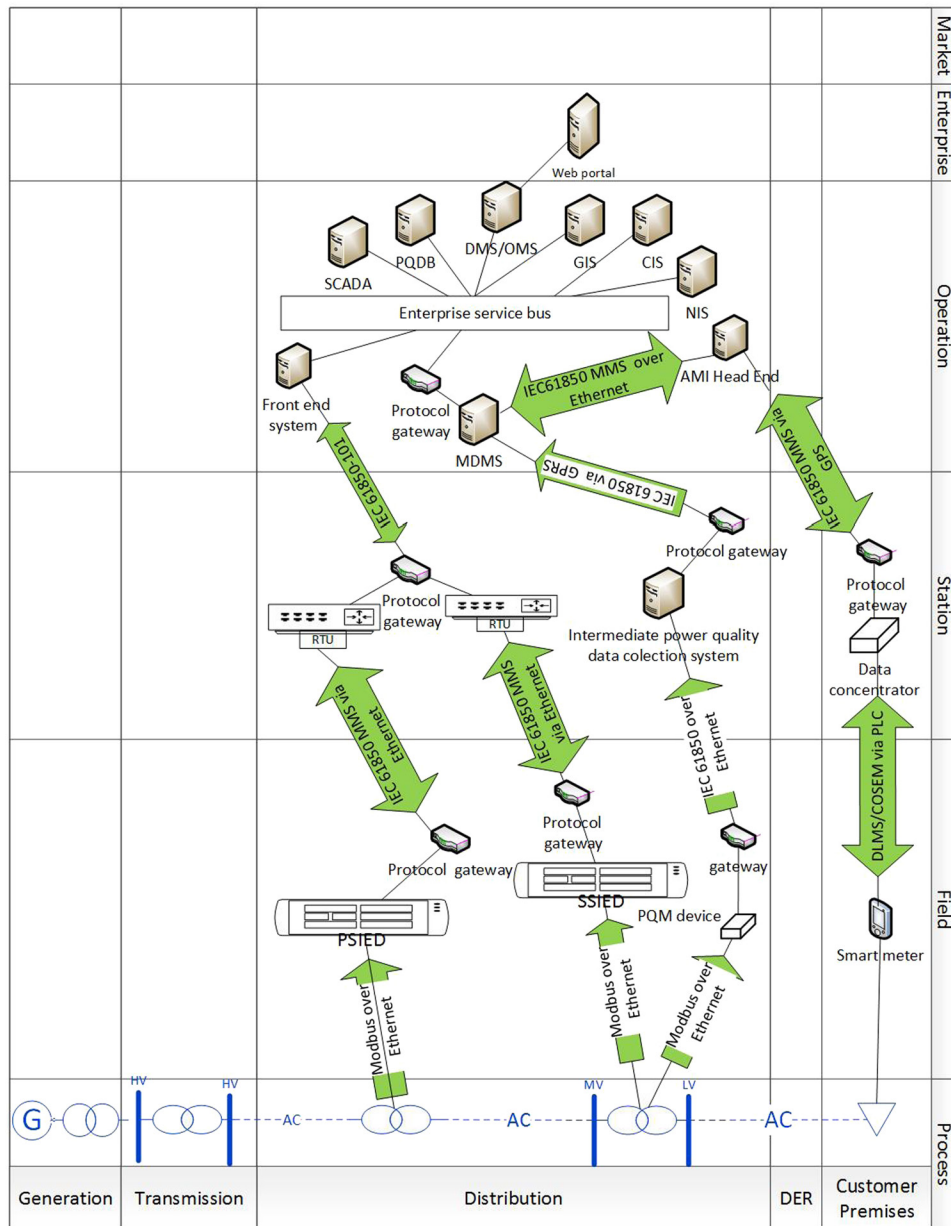


Figure 7: Communication layer (Uslar et al., 2019; Neureiter et al., 2015).

Figure 7 depicts the mapping of the use cases into SGAM layers. The communication media and communication protocols used in the mapping process are explained in detail in this section.

Communication technologies

There are many telecommunication technologies used for LV network monitoring, and these technologies are typically differentiated by a transmission medium. These communication technologies are divided into wired and wireless communication (Andreadou et al., 2016; Vikram and Sahoo, 2017).

Wired communication

The wired technologies provide reliability and security and allow higher communication capacity, but they are more expensive to implement in vast areas. As compared to wireless technologies, wired technologies are characterized by the higher cost of construction and low latency (Chaves et al., 2018). A few examples of wired technologies are power line communication (PLC) and optical fiber cable etc.

PLC: PLC is widely used for data transmission between smart meters and DC. In PLC, the data are transmitted over existing power lines, which reduces the cost of deployment of cables (there is no need for any infrastructure for data transmission). The PLC technology is classified into broadband PLC (BB-PLC) and narrowband (NB-PLC). In narrowband PLC, the data are transmitted via a narrow frequency band at a low bit rate. Typically, NB-PLC is preferred for home automation and usually applied as a communication link between SMs and DC. Though BB-PLC operates on the hundreds of Mbit/s (data rate) with an operating frequency of 2 and 30MHz, and it is used as a communication media between medium voltage (MV) & LV distribution network for data transmission between substation and control center (Andreadou et al., 2016).

Due to limited coverage of PLC, several repeaters are connected for data transmission between SMs and DCs depending upon the distance between the smart meter and DC. The selection of communication media also varies for the number of connected SMs per DC and environment type (rural, urban, and suburban). In addition to limited coverage, the two drawbacks of PLC are electric signal attenuation and random interference (Panchadcharam, 2012). The data rate of PLC is traditionally minimal, although this has been improved with more modern standard (PLC PRIME) (Kauppinen et al., 2012). The disadvantage

of PLC compared with wireless solutions is that it is likely to fail in the case of fault at the feeder (e.g., short circuit fault). In contrast, wireless communications do not rely on feeder cables as their propagation medium (data transmission medium) (Grilo et al., 2017).

PLC is the cheapest solution because it sends the data over power lines. There might be a need to build new infrastructure (in some areas), but there is no need to buy a licensed frequency spectrum or deploy the communication network. PLC consumes more power of the battery of a smart meter, and it reduces the life span of the battery, which increases the maintenance cost of a smart meter in case of outage alarm. For an outage alarm, a smart meter needs a lot of power to transmit signals over power lines.

Optical fiber communication: This technology is widely used for interconnecting substations with the control center. One of the barriers to adopting this technology is its installation cost. Otherwise, this technology provides many benefits compared to other wireless technologies (Long-Term Evolution (LTE)). This technology has a higher bandwidth for two-way communication in AMI applications, and another advantage is its robustness against electromagnetic and radio interference.

Wireless communication

The wireless communication provides faster data transmission than wired communication. Several improvements have been made in wireless communication technology, such as data rate, capacity, bandwidth, throughput, security, and latency, making it a preferable solution for the distribution network. The key points that are considered for wireless communication for longer distance are latency and throughput (Rathee et al., 2020; Sharma et al., 2019). Table 2 shows the comparison of different communication technologies (wired and wireless) concerning the data rate and coverage.

After knowing the data range (data rate) and coverage requirement of different communication technologies, DSO can choose the communication technology based on its application for the distribution network.

Application of communication technologies in one case study

Nowadays, the choice of communication technology in terms of requirements set by DSO for the power system is a challenging task. As the number of smart meters is increasing, the generated data from SMs

Table 2. Comparison of communication technologies (Kuzlu et al., 2014).

Technology	Standard/Protocol	Data rate (max. theoretical)	Data rate (average)	Coverage range (theoretical)	Coverage range (NLOS)
<i>Wired communication</i>					
PLC	Narrowband	10–500 kbps	21–128 Kbps	Up to 3 km	
	Broadband	500 Mbps	100 Mbps	1–3 km	
Fiber Optic	SONET/SDH	10 Gbps	NA	Up to 100 km	
	WDM	40 Gbps	NA	Up to 100 km	
<i>Wireless communication</i>					
WLAN	802.11x	2–600 Mbps	NA	Up to 100 m	
WIMAX	802.16	75 Mbps	40 Mbps	Up to 50 km	1–5 km
Cellular	2 G (GSM, CDMA)	14.4 Kbps	9.4–14.4 kbps	Up to 50 km	1–10 km
	2.5 G (GPRS)	144 Kbps	30–40 Kbps		1–10 km
	3 G (UMTS, Edge, CDMA 2000 1*EV-DO/DV)	Up to 2 Mbps	200–400 Kbps		1–10 km
	3.5 G (HSPA)	14 Mbps	5 Mbps		1–10 km
	4 G (LTE)	100 Mbps	33 Mbps		1–5 km

risers as well. In real-time operation, the response time, latency, and throughput are the key points for analyzing faster data transmission (Poongodi et al., 2019). One scenario (outage alarm) is taken from the thesis (Panchadcharam, 2012), where three technologies (PLC, Universal Mobile Telecommunications System (UMTS) and Global Positioning Radio System (GPRS)) are compared in terms of high-speed communication. These communication technologies are compared by considering DSO's requirements in (Panchadcharam, 2012) for the scenario of outage alarm shown in Table 3.

Table 3 presents the performance of communication technologies for the outage alarm. It can be seen from Table 3 that as the number of meters is increased, the required data rate per packet is also increased exponentially. Suppose, for 200 smart meters, and a response time of 5 s, the data rate per packet is 191 kbps. To keep the same response time by doubling the number of smart meters (400 smart meters), the data rate should also be increased two times. Table 4 shows the throughput and latency requirements of different communication technologies over transmission control protocol (TCP) and universal datagram protocol (UDP).

The appropriate communication technology is chosen by matching the data rate and latency

requirement of Table 3 with Table 4 by considering throughput and latency values. The throughput for GRRS over UDP and TCP is 21–22 kbps. According to Table 3, this data rate requirement (21 kbps) is used for 800 smart meters with the minimum response time of 3 min. The GPRS can support 800 smart meters with this throughput (21 kbps) requirement. For beyond and below to these requirements (if we increase or decrease the number of smart meters and response time), the GPRS is not a valid option for communication technology.

The selection of communication technology (based on the different number of SMs and response time) keeps the following conditions:

- If the requirement for sending an alarm to the SCADA system is within 3 min for 10,000 meters, UMTS over UDP and PLC can be used.
- PLC is the only solution for 10,000 meters if response time is 30 s (Panchadcharam, 2012).

Different communication architectures are studied for deciding the suitable communication infrastructure for the use cases of this paper. Kuzlu et al. (2014) have identified three types of communication architectures based on reviewing the architectures

Table 3. Comparison of response time with data rate for the number of smart meters (Andreadou et al., 2016).

	Response time (5 s)	Response time (30 s)	Response time (3 m)	Response time (5 m)	Response time (15 m)	Response time (1 h)	Response time (12 h)
Smart meters	Data rate per packet (kbps)	Data rate per packet (kbps)	Data rate per packet (kbps)	Data rate per packet (kbps)	Data rate per packet (kbps)	Data rate per packet (kbps)	Data rate Per packet (kbps)
200	191	32	5	3	1	0	0
400	382	64	11	6	2	1	0
600	573	96	16	10	3	1	0
800	764	127	21	13	4	1	0
1,000	955	159	27	16	5	1	0
5,000	4,776	796	133	80	27	7	1
10,000	9,552	1,592	265	159	53	13	1

Table 4. Comparison of various communication technologies based on throughput and latency (Vikram and Sahoo, 2017).

Communication Media	UDP		TCP	
	Throughput	Latency	Throughput	Latency
GPRS	22 kbps	6 sec	21 kbps	10 s
UMTS	363 kbps	102 ms	239 kbps	311 ms
PLC	50.3 Mbps	3.1 ms	13.4 Mbps	95 ms

used in different projects. The first architecture is direct communication through a mobile network operator. The second architecture adopts PLC/broadband over power lines (BPL) gateway, and the third one uses a PLC/BPL DC. For selecting the most suitable communication architecture of this paper, the technical and functional points of view are covered for three types of architectures. In addition to technical and functional point of views, the advantages, limitations, and usage of architectures in different projects are also discussed. Chren et al. (2016) have concluded that the most adopted deployment of communication infrastructure is based on DC-based architecture. The second most adopted

architecture is the gateway, and the lower number of communication infrastructure deployments employ the peer-to-peer (P2P) or wireless architecture. The following reasons are given for selecting the specific deployment of communication architecture:

- In terms of sufficient network quality of the mobile network, wireless technology is the most straightforward technique. Still, this network has several legal and organizational issues that can be solved in cooperation with a mobile network operator.
- As compared to wireless technology controlled and managed by a mobile network operator,

the DC infrastructure is owned and operated by DSO, which makes it more challenging from the technical point of view. One reason for using DC is that it adds more functionalities (decentralized automation, data mining), to make the distribution network smarter.

- The most problematic architecture from the technical point of view is the gateway architecture, because of its communication media (PLC/BPLC or mobile network), which impacts other systems. This is the second most deployed architecture in different projects. Table 5 shows

Table 5. Comparison of different architecture styles for AMI applications (Chren et al., 2016).

Communication technology	Advantages	Disadvantages	Risks
Direct Communication (Mobile Network Operator)	<p>Direct communication (GPRS, code division multiple access, LTE) over a mobile network</p> <p>Simple for monitoring and management of AMI infrastructure</p>	<p>High demand for mobile network infrastructure for data collection and control</p> <p>Part of the responsibilities are handled by a mobile operator</p> <p>The quality of the network will be lower if there is not sufficient coverage of mobile signal and a local gateway is used</p> <p>This communication architecture does not support local control/ (decentralized control at the secondary substation). In this case, the data are collected at the control center and transmitted to local control</p>	<p>Difficult to switch mobile operator (all communication models and meter points will be changed)</p> <p>Most of the communication technologies are owned and managed by the third party</p> <p>Legal and organizational issues because of cyber security laws in some countries</p>
Communication using PLC/BPL DC	<p>Hybrid communication infrastructure (PLC/BPLC is used for communication between SMs and DC, while a mobile network is used between DC and control center)</p>	<p>More challenging and demanding from monitoring and infrastructure point of view</p>	<p>The volume of the communication on the PLC/BPL layer is not significant from the economic point of view, which involved higher cost in building and maintaining the communication infrastructure</p> <p>Security weakness due to the availability of temporary data storage at DC</p>
Communication using PLC/BPL Gateway	<p>The operator communicates with SMs through a gateway (PLC communication is used between a gateway and SMs, and wireless communication is used between a gateway and operator)</p> <p>The gateway can be placed either at local control (secondary substation) or at home</p>	<p>The speed, reliability and latency of communication channels are affected due to dynamic route of connection between PLC and mobile network</p>	<p>The gateway only responses the request between SMs and control center, and does not store any data</p>

the comparison of different architectures for AMI applications concerning their advantages, disadvantage and risks.

Considering these points (different communication infrastructures used in different projects and comparison of various communication technologies), the PLC technology is used in our use cases for the data transmission between smart meters and DC. In contrast, wireless communication technology is chosen between DC and control center. This hybrid communication infrastructure is selected by keeping the limitations of PLC and the cost of infrastructure.

After selecting the communication media for this paper's use cases, the next step is to identify the protocols that support the data transmission process.

Communication protocols and standards

The communication protocols define the set of rules for data transmission among different devices in the communication network. The communication protocol supports devices from different manufacturers with various specification to share the information in the same language. Most of the communication protocols follow the open system interconnect (OSI) model layer structure. The OSI model consists of seven layers that illustrate how data are processed from each layer and each layer's function during data transmission. The data transmission can be serial, parallel, or peer-to-peer communication, and it depends upon the supporting protocols, bandwidth, communication channel, and supporting communication media. This section gives the brief introduction of communication protocols that support the selected communication infrastructure employed for the use cases of this paper.

DLMS/COSEM protocol

DLMS stands for device language and message specification, while COSEM stands for companion specification for energy metering. The DLMS and COSEM are two different standards used together (DLMS/COSEM) as a communication protocol for meter data exchange. The DLMS (IEC 62056-53) is the suite of standards maintained by DLMS user association that provides the interoperable environment for meter data exchange, while COSEM (IEC 62056-62) is an object-oriented model for meter communication interface that gives the complete description of functionalities and carries the set of specifications. The specifications of COSEM are used to define the transport and application layer for DLMS

protocol. The DLMS/COSEM works on the client/server-based architecture (meter acts as a server, and DC acts as a client) and operates on the application layer (an upper layer of the OSI model). Each layer of the OSI model performs different tasks, and lower layers of the OSI model provide services to an upper layer. The type and the number of lower layers are dependent on the used communication media (Dedé et al., 2015).

In smart metering applications, the DC polls the smart meters for data acquisition. Like poll command, the push command is also introduced in DLMS/COSEM for the event notifications. The notification of events generated by smart meters can be sent to DC without any ping request created by DC. As compared to report service approach used by IEC 61850, this approach performs the same actions (Dedé et al., 2015).

Modbus

Modbus (an application layer communication protocol) belongs to the family of field bus protocols, and they are widely used in industrial automation applications. The Modbus supports the communication between RTU, meters and other field devices via a serial line, and it uses the recommended standard (RS-485 or RS-232) for data transmission. Modbus communication is possible by master/slave architecture in which the master sends the request and slave responds to the request (Camachi et al., 2017).

IEC 61850

The IEC 61850 is the international standardized protocol (object-oriented standard) used for substation automation communication. The advantage of using IEC 61850 is that it provides an abstract data model and an abstract communication interface. The IEC 61850 is the part of the IEC technical committee (TC 57) reference architecture that defines the standardized names, the meaning of data, device behavior models, and abstract services (Camachi et al., 2017).

The IEC 61850 is also used beyond the substation such as communication for wind and hydroelectric power plants. IEC 61850 can be mapped into manufacturing message specification (MMS) protocol (an OSI protocol that runs over TCP/IP, where IP stands for internet protocol. Moreover, it also provides the interoperability between IEDs which are manufactured by different vendors (León et al., 2016).

The interface model of IEC 61850 is broken down into logical devices and further divided into logical nodes. Before exporting the data from RTU to

SCADA, the data sets are defined, which reflect that what kind of services are subscribed by a client. Both DLMS/COSEM and IEC 61850 can be compared in terms of transporting information for smart metering application (Dedé et al., 2015).

The IEC 61850 supports different types of messages from different performance classes, and they are mapped to different protocols. The grouping of messages is based on the specific requirement of the message type. In other words, the message of the same requirements is grouped and mapped to the same message type protocol (Kuzlu et al., 2014). Figure 8 shows the message type grouping and their mapping into different protocols.

IEC 61850 MMS

MMS defines the set of encoding rules for mapping the messages to bits or bytes during transmission. MMS operates over client-server architecture and supports the services of IEC61850. The IEC 61850

services are mapped into MMS protocol using over TCP/IP of OSI model and running over layer three on ethernet (a popular local area network protocol). The preferable solution for MMS is to use it for data communication between field devices and from DC to AMI head-end (León et al., 2016).

CIM

The CIM stands for common information model, and it is an object-oriented data model in the power system. CIM is used to define the object classes, object attributes, and the relationship to other classes. It is used as a common data exchange model for application integration. In other words, it is used for the exchange of information (information about the configuration and status of the network) between applications in operation and business layers of SGAM. CIM is not a database, but it is a method for storing and organizing the data. For standardized communication between different communication

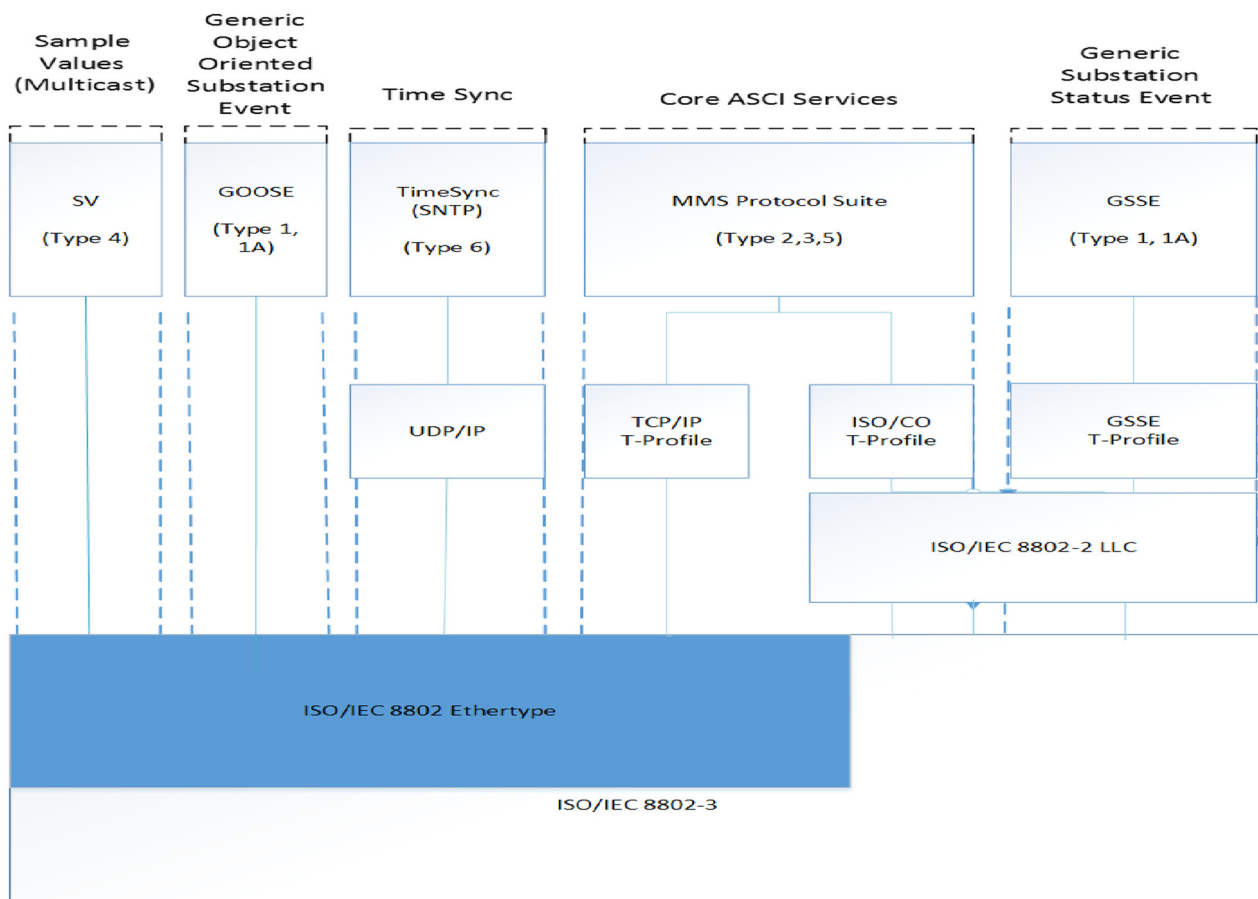


Figure 8: Message type grouping of protocols for IEC 61850 suit (Arnold et al., 2010).

systems, CIM defines the semantics for all CIM supported communication systems. The standards that come in CIM category are IEC 61968 and IEC 61970 (Arnold et al., 2010). Table 6 shows the specific application of different standards.

Discussion

The smart meters generate different events; some are set by DSO and some by the manufacturer. These events are meter/device status events (last gasp or power store), meter temper flags, and meter hardware information (low battery alarms, battery critical). Besides these events, there are alarms which are generated based on voltage threshold levels set by DSO. These alarms are as follows: phase missing, neutral conductor fault, asymmetrical voltage, and voltage unbalance (over and under voltage) (Repo et al., 2011).

The unnecessary alarms (alarm followed by another alarm) must be avoided and prioritized before sending it to DMS. The unnecessary alarms create overwhelming data that produce congestion in the communication network and increase data transfer power consumption. To avoid unnecessary alarms, the alarm filtration algorithm can be utilized

at DMS or at the SCADA system, which depends on the architecture (topology) and the length of the network.

A DSO can prioritize the alarms, and one example of prioritization of alarm is set by Elenia Oy in Finland, which is described below.

The priority is given to the phase missing alarm (phase fault) when the phase fault is identified. The second priority is set for an asymmetrical voltage alarm that indicates the neutral conductor fault. The third priority is given to phase unbalance voltage alarms (Kauppinen et al., 2012).

For finding the exact fault location or affected smart meters, queries are generated. The queries are created by a system operator and can be classified as manual, semi-automatic and fully automatic. The manual query can be sent by DMS/OMS to smart meters at any time. The semi-automatic query is generated after receiving the alarm notification. These queries are created to know the meters' status (either meters are on the same feeder or different feeders). On the other hand, the fully automated queries are used for a weak network; an automated query is issued at least once in a day for analyzing the network (Kauppinen et al., 2012). When a query

Table 6. Standards, along with their application and comments as applied in SGAM (Arnold et al., 2010).

Standard	Application	Comments
DLMS/COSEM	This standard is mainly used to support communication between smart meters and DC. A few applications of this standard are: electricity meter data reading and exchange, support of outages and power quality alarms, tariff and load control	DLMS User group
IEC 61850	This standard was first designed to provide the communication between substations, and now it is used for the communication between the control center and substation for monitoring and controlling purpose. However, it can also be used beyond substation communication. For example; for communication between DERs and substation, but these protocols or standards are still in practice	This standard is open, maintained and developed by IEC
IEC 61968/61970/ IEC62325 suite (CIM)	These standards are used to define the systemic model for data exchange. The IEC 61970 is used for interface-related application and the energy management system, while IEC 61968 is used to transfer information between different systems at the control center. For the data exchange to DSO and energy markets, IEC 62325 standard is used	These standards are open, maintained and developed by IEC
IEC 62351	This standard is used to define the information security for data exchange and power control-related operations	This standard is open, maintained and developed by IEC

is created by DMS and received by smart meters, the following responses can be seen by smart meters:

- Device responding (no alarm).
- Device responding (active alarm).
- Device not reached (due to communication network problem or fault in the network).
- Device unknown (no record of a device in the database).
- Device switched off (switched off due to fault or customer has not paid the bill) (Repo et al., 2011).

The designing of use cases and then mapping them into the SGAM framework is the main contribution of this paper. Moreover, this research paper will help the network operating company and DSO to design a suitable communication network associated with specific protocols for data communication to SCADA or to make the distribution network as an active network.

Conclusions and future scope

This paper aims to describe a process to monitor the LV network problems (outage, power quality) using smart metering events by designing use cases. The use cases have shown the involvement of different actors and systems in the monitoring process, which are later mapped into SGAM framework to see the monitoring process in a pictorial format. Communication technologies and communication protocols between actors and systems or between different systems play an essential role in the monitoring process. For that purpose different communication infrastructures, communication technologies and protocols are discussed in this paper. For the designed use cases of this paper, PLC with GPRS (hybrid solution) communication infrastructure is selected for the communication between SMs and control center based on the key performance indicators (latency and throughput) of different communication technologies and by reviewing different communication infrastructures used in different projects. In communication protocols, DLMS/COSEM is chosen to support PLC communication between SM and DC. At the same time, IEC 61850 is selected to support the communication between field devices and the control center over ethernet. In future, the designed use cases can be further developed by adding more functionalities (by implementing data mining algorithms) in PQDB and MDMS. Moreover, the proposed smart platform can be confirmed by incorporating simulated test cases.

List of Acronyms:

- AMI= Advanced Metering Infrastructure
- AMR = Automatic Meter Reading
- CIM= Common Information Model
- BPL= Broadband Power Line
- CIS= Customer Information System
- COSEM= Companion Specification for Energy Metering
- DC= Data Concentrator
- DER= Distributed Energy Resources
- DLMS= Device Language and Message Specification
- DMS= Distribution Management System
- DSO = Distribution System Operator
- ESB= Enterprise Service Bus
- GIS= Global Information System
- GPRS= Global Positioning Radio System
- ICT= Information and Communication Technology
- IED= Intelligent Electronic Device
- IP= Internet Protocol
- LTE= Long Term Evolution
- LV= Low-Voltage
- MDMS= Meter Data Management System
- MMS=Manufactured Message Specification
- MV= Medium Voltage
- NIS= Network Information System
- OMS= Outage Management System
- OSI= Open Information System
- P2P= Peer to Peer
- PLC= Power Line Communication
- PQDB= Intermediate Data Collection System for Power Quality
- PQM= Power Quality Meter
- RTU= Remote Terminal Unit
- SCADA= Supervisory Control and Data Acquisition
- SGAM= Smart Grid Architecture Model
- SM= Smart Meter
- SOA= Service-oriented Architecture
- TCP= Transmission Control Protocol
- UDP= Universal Datagram Protocol
- UMTS = Universal Mobile Telecommunication System

Literature Cited

Amaripadath, D., Roche, R., Istrate, D., Fortune, D., Braun, J. P. and Gao, F. 2017. "Power quality disturbances on smart grids: overview and grid measurement configurations," *2017 52nd International Universities Power Engineering Conference (UPEC)*, Heraklion, pp. 1–6, doi: 10.1109/UPEC.2017.8231975.

- Andreadou, N., Guardiola, M. O. and Fulli, G. 2016. "Telecommunication technologies for smart grid projects with focus on smart metering applications", *Energies* 9(5), doi: 10.3390/en9050375.
- Arnold, G. W., Wollman, D. A., FitzPatrick, G. J., Prochaska, D. E., Lee, A., Holmberg, D. G., Su, D. H., Hefner, A. R., Jr, Golmie, N. T., Simmon, E. D. et al. 2010. "Nist framework and roadmap for smart grid interoperability standards release 1.0," Special Publication (NIST SP)-1108.
- Bruinenberg, J., et al. 2012. *CEN-CENELEC-ETSI: Smart Grid Coordination Group – Smart Grid Reference Architecture Report 2.0*, November.
- Camachi, B. E. M., Chenaru, O., Ichim, L. and Popescu, D. 2017. "A practical approach to IEC61850 standard for automation, protection and control of substations," *2017 9th International Conference on Electronics, Computers and Artificial Intelligence (ECAI)*, Targoviste, pp. 1–6, doi: 10.1109/ECAI.2017.8166471.
- Chaves, M. T. C., Barbosa, R. S. and Amorim, L. M. C. 2018. "Smart metering communication performance analysis in EDP Distribuição", *CIREN Workshop*, No. 103, pp. 7–8.
- Chren, S., Rossi, B. and Pitner, T. 2016. "Smart grids deployments within EU projects: the role of smart meters", *2016 Smart Cities Symposium Prague (SCSP)*, doi: 10.1109/SCSP.2016.7501033.
- Dedé, A., Della Giustina, D., Rinaldi, S., Ferrari, P., Flammini, A. and Vezzoli, A. 2015. "Smart Meters as part of a sensor network for monitoring the low voltage grid", Vol. 00416.
- Grilo, A., Casaca, A., Nunes, M., Bernardo, A., Rodrigues, P. and Almeida, J. P. 2017. "A management system for low voltage grids", *2017 IEEE Manchester PowerTech* 2017: 1–6, doi: 10.1109/PTC.2017.7980826.
- Kauppinen, M., et al. 2012. "Analysis of needs and available solutions for second-generation AMR support for Smart Grids".
- Kuzlu, M., Pipattanasomporn, M. and Rahman, S. 2014. Communication network requirements for major smart grid applications in HAN, NAN and WAN. *Computer Networks* 67: 74–88, doi: 10.1016/j.comnet.2014.03.029.
- León, H., Montez, C., Stemmer, M. and Vasques, F. 2016. "Simulation models for IEC 61850 communication in electrical substations using GOOSE and SMV time-critical messages", *2016 IEEE World Conference on Factory Communication Systems (WFCS)*, Aveiro, pp. 1–8, doi: 10.1109/WFCS.2016.7496500.
- Löf, N., Pikkariainen, M., Repo, S. and Järventausta, P. 2011. "Utilizing smart meters in LV network management", *21st International Conference and Exhibition on Electricity Distribution CIREN*, No. 1050, pp. 6–9.
- Neureiter, C., Engel, D., Trefke, J., Santodomingo, R., Rohjans, S. and Uslar, M. 2015. "Towards consistent smart grid architecture tool support: from use cases to visualization", *IEEE PES Innovative Smart Grid Technologies Conference Europe*, 2015(January): 1–6, doi: 10.1109/ISGTEurope.2014.7028834.
- Panchadcharam, S. 2012. "Performance evaluation of information and communications technology infrastructure for smart distribution network applications", January, pp. 1–163.
- Pikkariainen, M., Löf, A., Lu, S., Pöhö, T., Repo, S. and Della Giustina, D. 2013. "Power quality monitoring use case in real low voltage network," *2013 4th IEEE/PES Innovative Smart Grid Technologies Europe ISGT Europe*, pp. 1–5, doi: 10.1109/ISGTEurope.2013.6695405.
- Poongodi, M., Hamdi, M., Sharma, A., Ma, M. and Singh, P. K. 2019. "DDoS detection mechanism using trust-based evaluation system in VANET," *IEEE Access* 7: 183532–183544, doi: 10.1109/ACCESS.2019.2960367.
- Radi, M., Taylor, G., Uslar, M., Kohlke, J. and Suljanovic, N. 2019. "Bidirectional power and data flow via enhanced portal based TSO-DSO Coordination", *2019 54th International Universities Power Engineering Conference (UPEC)*, doi: 10.1109/UPEC.2019.8893602.
- Rathee, G., Sharma, A., Kumar, R., Ahmad, F. and Iqbal, R. 2020. "A trust management scheme to secure mobile information centric networks," *Computer Communications* 151(December): 66–75, doi: 10.1016/j.comcom.2019.12.024.
- Repo, S., Della Giustina, D., Ravera, G., Cremaschini, L., Zanini, S., Selga, J. M. et al., 2011. "Use case analysis of real-time low voltage network management," *Proceeding of ISGT Europe*, 8(December 5–7): 1.
- Sharma, A. et al. 2019. "A secure, energy-and SLA-Efficient (SESE) E-Healthcare framework for quickest data transmission using cyber-physical system," *Sensors (Basel, Switzerland)*, 19(9): 2119, doi: 10.3390/s19092119.
- Sharma, A., Singh, P. K., Sharma, A. and Kumar, R. 2019. "An efficient architecture for the accurate detection and monitoring of an event through the sky," *Computer Communications* 148(July): 115–128, doi: 10.1016/j.comcom.2019.09.009.
- Uslar, M., et al 2019. "Applying the smart grid architecture model for designing and validating system-of-systems in the power and energy domain: a European perspective," *Energies* 12(2), doi: 10.3390/en12020258.
- Vikram, K. and Sahoo, S. K. 2017. "Load aware channel estimation and channel scheduling for 2.4GHz frequency band based wireless networks for smart grid applications," *International Journal on Smart Sensing and Intelligent Systems* 10(4): 879–902, doi: 10.21307/ijssis-2018-023.
- Wang, P., Su, F., Hu, B. and Luan, W. 2016. "AMI based sensing architecture for smart grid in IPV6 networks. *International Journal on Smart Sensing and Intelligent Systems* 9(4): 2111–2130, doi: 10.21307/ijssis-2017-955.